


28000 WATTS CONTINUOUS USING 10 FX2548'S AND TURBOS

BYPASS IS ACCOMPLISHED USING AN EXTERNAL 200 AMP TRANSFER SWITCH
 5 100 AMP BREAKERS PER PSDC 2 X-240'S AND THEIR BREAKERS

AC INPUT AND AC OUTPUT BREAKERS
 DUAL 1/0 FEED IN AND OUT TO TBBS

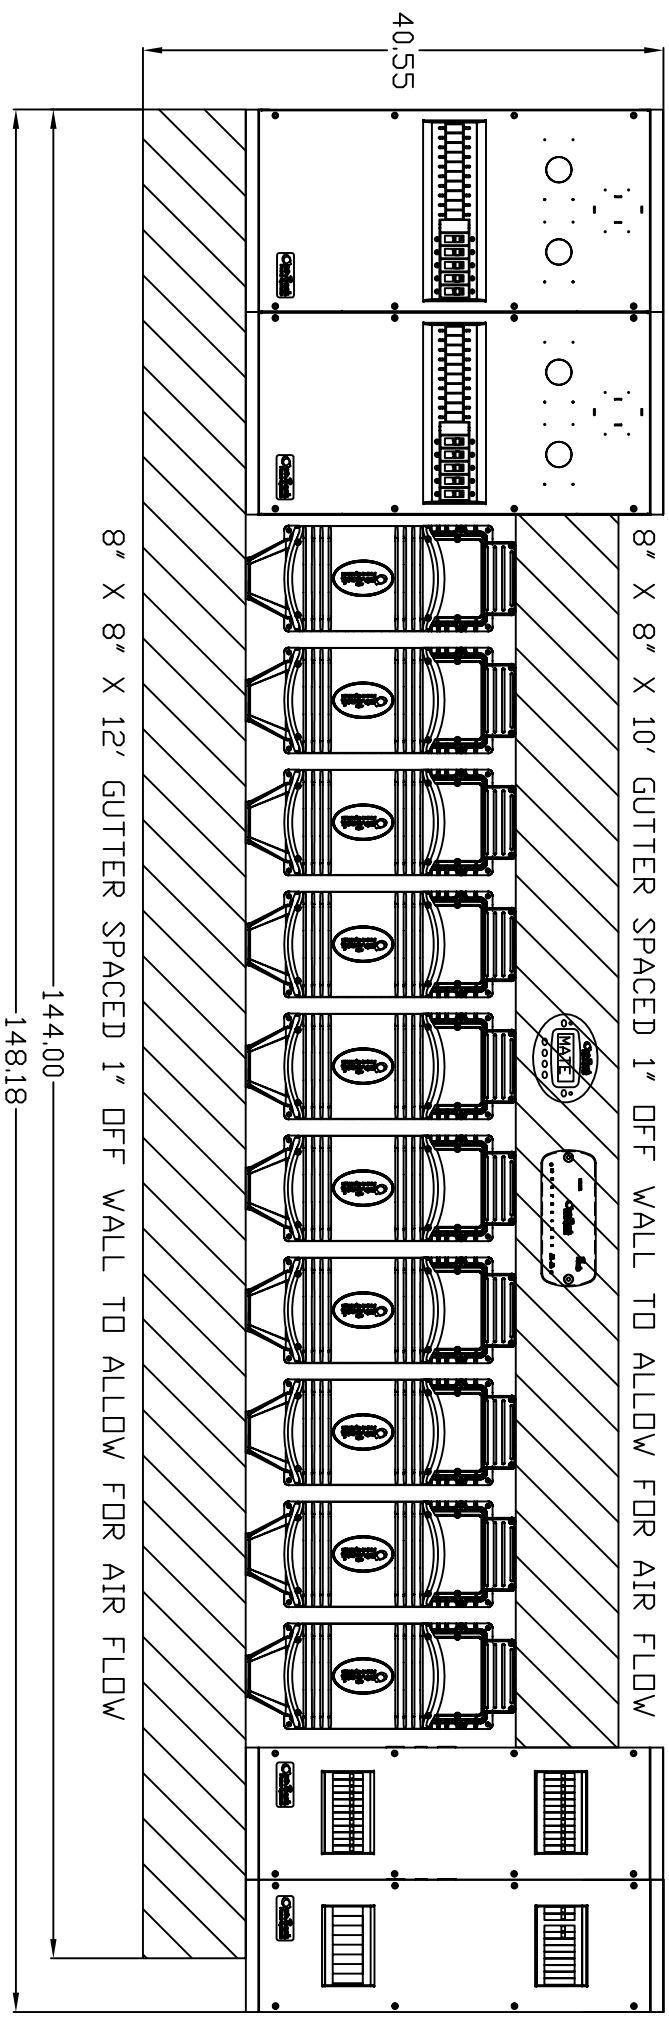


Outback Power Systems 19009 62nd Ave. N.E. Arlington, Wa. 98223 U.S.A. Phone 360-435-6030	Tolerances XX = ±.02 XXX = ±.010 Angles ±2° Unless otherwise noted Break all sharp corners	Title TEN STACK SERIES / PARALLEL
	File Name Robin Gudgel File Name 2-28-04	File Name 10STACK

Information on this drawing is proprietary to Outback Power Systems Inc.

Sh't 1 of 2 REV -

LEG 1

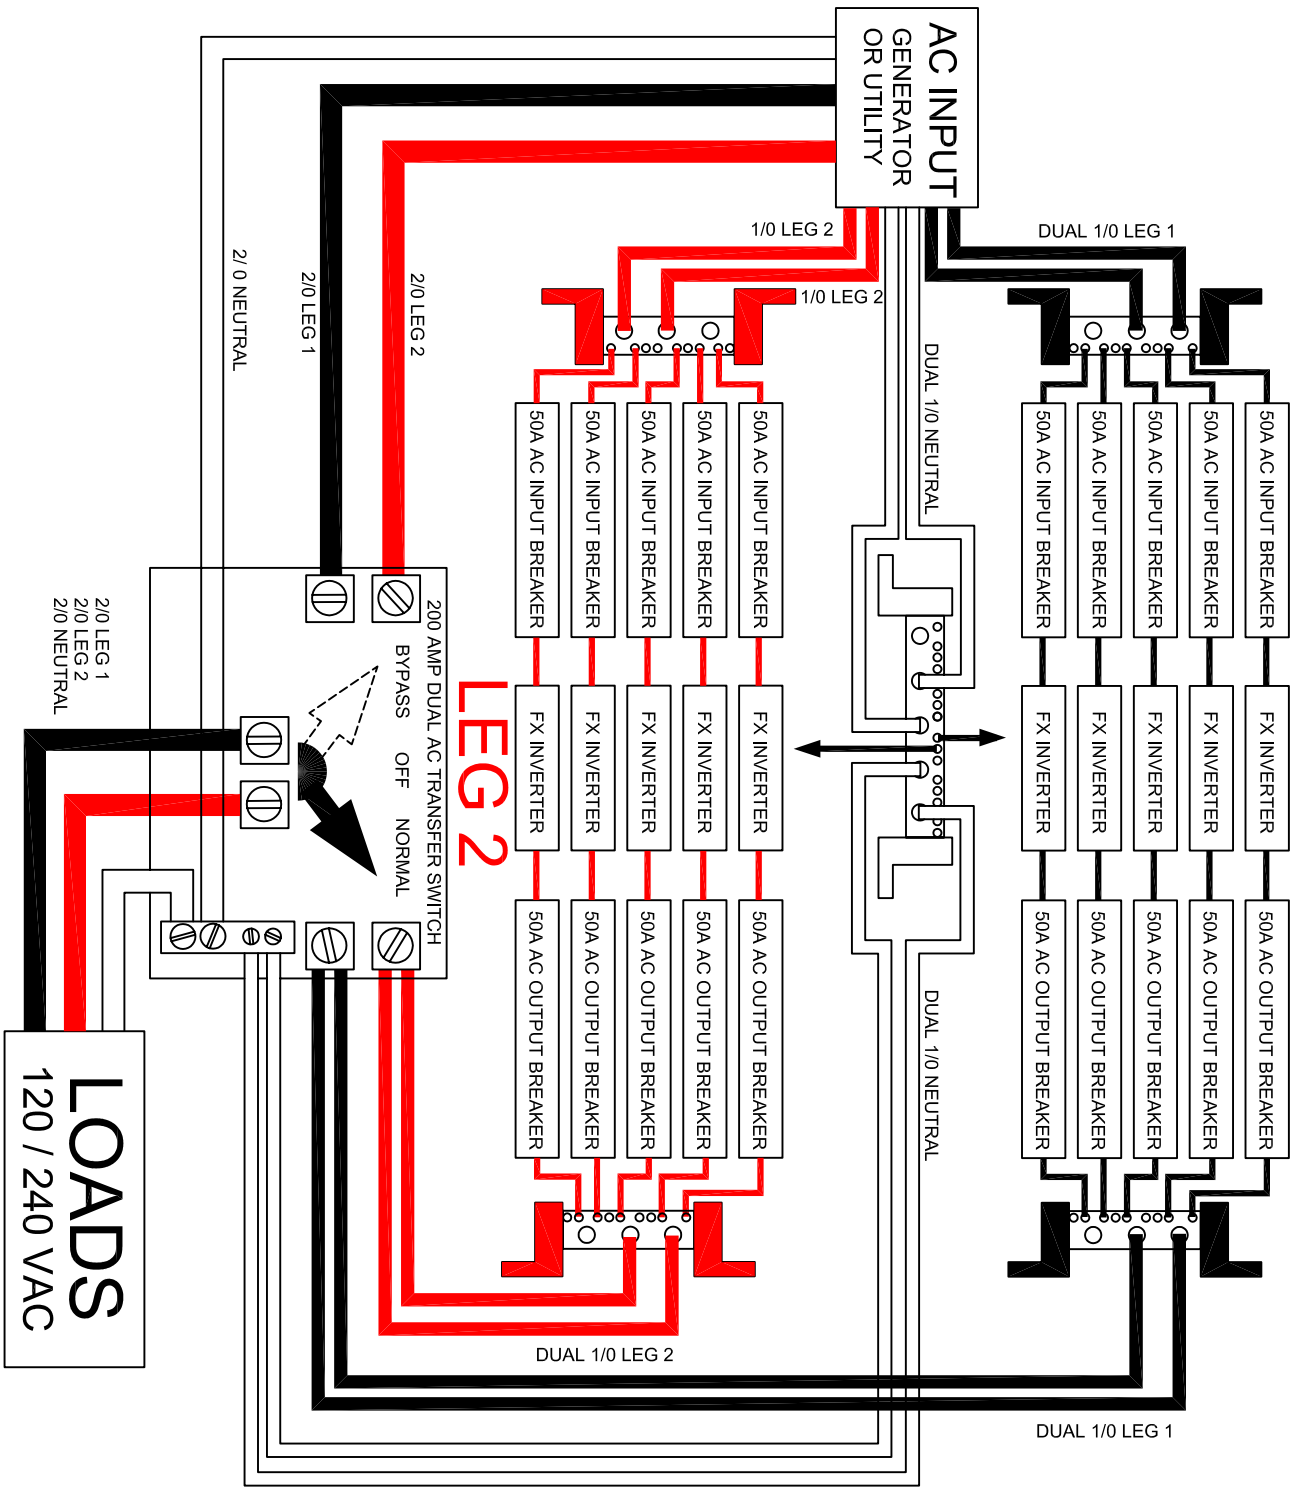

LEG 2

1. THE TRANSFER SWITCH SHOWN IS AVAILABLE FROM MOST ELECTRICAL SUPPLY DISTRIBUTORS OR FROM GRAINGER.
2. THE BUSBARS SHOWN ARE THE STANDARD OUTBACK LENGTH. LONGER BUSBARS ARE AVAILABLE FOR MORE HOLES.

Outback Power Systems
 19009 62nd Ave. N.E.
 Arlington, Wa. 98223 U.S.A.
 Phone 360-435-6030

Tolerances
 XX = ±.02
 XXX = ±.010
 Angles ±2°
 Unless otherwise noted
 Break all sharp corners

File Name: Robin Gudel
 File Name: 2-28-04

Title: TEN STACK SERIES / PARALLEL
 File Name: 10STACK

Sheet 2 of 2 REV -

Information on this drawing is proprietary to Outback Power Systems Inc.